

# WATER LEVEL TRANSMITTER

DATA SHEET FQK

This water level transmitter is used for measuring the level of clean water, sewage water, well, river, etc.

The detector is placed on the bottom of the water, and the water head pressure acting on the pressure receiving diaphragm is detected, converted into a current signal and then transmitted to a receiving instrument via the connector terminal

### **FEATURES**

1. Accuracy as high as  $\pm 0.2$  %

Excellent performance has been realized with a highly evaluated capacitance type silicon sensor and a microprocessor.

2. Powerful arrester built-in

Both detector and connector terminal are equipped with a lightning arrester to secure reliable lightning protection.

3. Remotely adjustable

This transmitter is remotely adjustable with a handheld communicator.

## **SPECIFICATIONS**

#### <Functional specifications>

Measurement item:

Water level of clean water, sewage

water, well, river, etc.

(Note: Avoid a vicinity of chemical

injection site.)

Measuring range:

0 to 1.5 ... 13 m

0 to 10 ... 50 m

Output: 4 to 20 mA DC

Power supply: 24 V DC (10.5 to 32 V) Wiring system: 2-wire system

Allowable load resistance:

0 to 600  $\Omega$  (at power supply of 24 V DC) Note: A load resistance of at least 250

 $\boldsymbol{\Omega}$  is required for communications with a

hand-held communicator.

Remote setting: Zero/span adjustments, range setting and

damping setting

(Settable with a hand-held communicator.)

Communication line conditions (when using hand-held

communicator): Line length; Max. 2 km

Load resistance; 250 to 600  $\Omega$  Load capacity; 0.22  $\mu F$  or less Load inductance; 3.3 mH or less

Saturation output:

Upper limit: 20.8 mA, lower limit: 3.8 mA



Damping: Time constant variable within 0 to 32 sec

(Settable with a hand-held communicator.)

Zero and span adjustments:

Adjustable from connector terminal or remotely adjustable with hand-held

communicator.

Zero point shift: ±35% of maximum measuring range

Span adjustable range:

10 to 100% of maximum measuring

ange

(Measuring range must not be exceeded.)

Liquid contacting temperature (detector):

0 to 50°C

Ambient temperature (connector terminal):

-20 to +60°C

Storage temperature:

-30 to +70°C

#### <Performance specifications>

Accuracy rating: ±0.2% of measuring span

Allowable overpressure:

Up to 2 times of maximum measuring

range

Temperature effect:

 $\pm$ (0.3 + 0.2 × URL / X) % /30°C URL; Upper range limit (13 or 50 m)

X; Actual measuring span

#### <Physical specifications>

Material (detector):

Pressure receiving diaphragm; SUS 316L

Outer tube; SUS 316

Hollow cable; PVC or PE covering

Enclosure: Detector: IP68

The pressure detector of the type for sewage water is provided with a sludge

protector.

Connector terminal: JIS C0920

immersion-proof type

Mass (weight) approx:

Detector; 2 kg

Connector terminal; 3.5 kg (excluding

cable)

Cable; 3 kg /10 m

Mounting method:

Detector; Suspended in water or placed

at water bottom.

Repeater; Mounted on 2B pipe or wall.

Arrester: Built in both detector and connector

terminal.

Lightning resistance

Detector: 10 kA, Repeater: 2500 A

 $(8/20 \mu s)$ 

### <Optional specifications>

Indicator (repeater):

Analog indicator

% scale or actual-value scale

Detector stand: For installing detector at water bottom

SUS 304 (\$\phi267, \$\phi180, \$\phi95 \cdots \text{by order})

Chain: SUS 316 (for hoisting the detector)

## **SCOPE OF DELIVERY**


Transmitter (detector + connector terminal, with hollow cable and pipe mounting bracket)

Detector stand and chain when specified at option,


## **RELATED DEVICE**

Hand-held communicator (type FXW. Refer to EDS8-47.)


# **SYSTEM CONFIGURATION (EXAMPLE)**

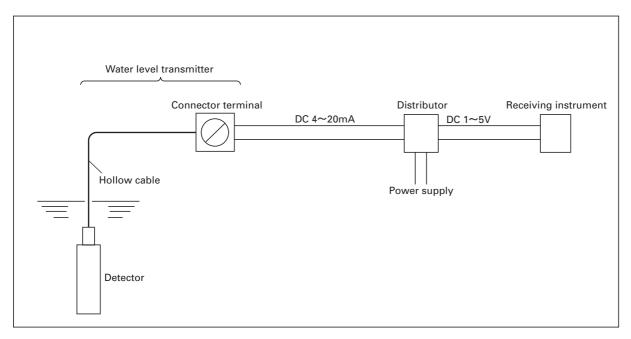


## **OPERATING PRINCIPLE OF DETECTOR**

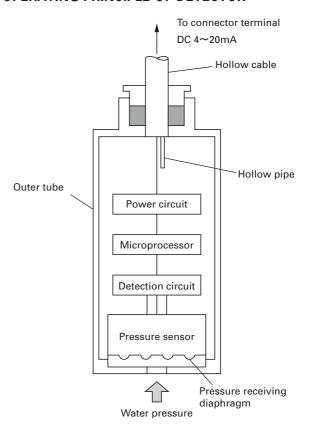

# **CODE SYMBOLS**

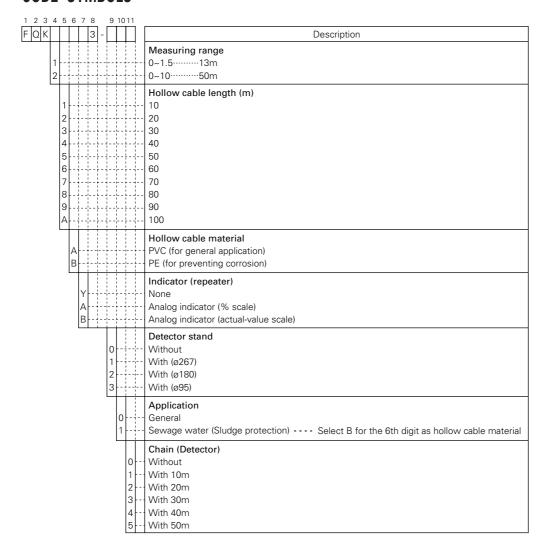


## **EXTERNAL CONNECTION DIAGRAM**



## **ORDERING INFORMATION**

- 1. Product name
- 2. Type
- 3. Measuring range

# **OUTLINE DIAGRAM (Unit: mm)**

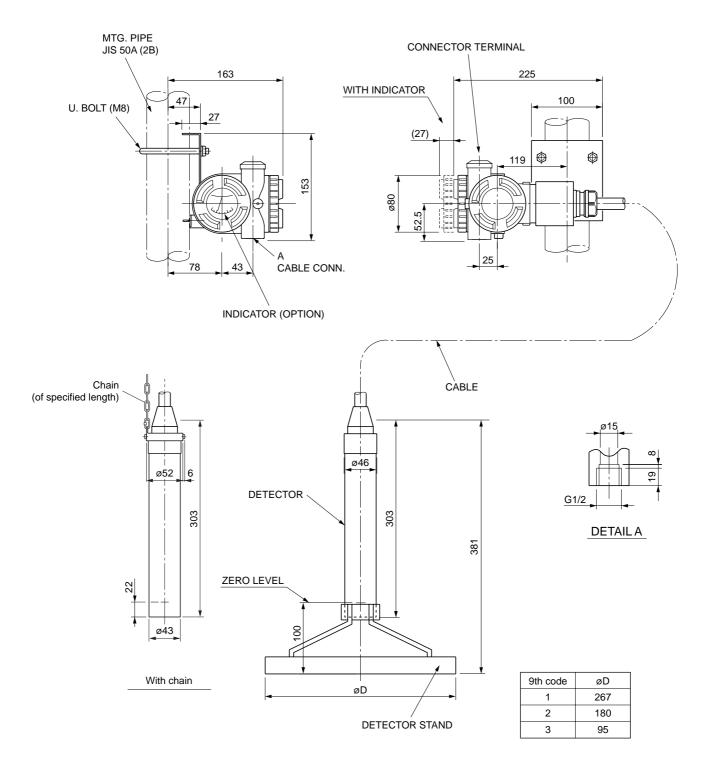

#### 

\*Before using this product, be sure to read its instruction manual in advance.



**Grobal Sales Section** Instrumentation & Sensors Planning Dept.

1, Fuji-machi, Hino-city, Tokyo 191-8502, Japan http://www.fujielectric.com Phone: +81-42-514-8930 Fax: +81-42-583-8275

http://www.fujielectric.com/products/instruments/